


# OFDA Micron Test Report

## Natural Fibre Centre

Date : 15Sep06 Mean = 26.28 u  
 Sample ID : MFI PBulletProof28Nov03 SD = 6.46 u  
 Description : M LF Hua 10May06 CV = 24.6 %  
 Lot/Client : Southern Star Farm Sample size = 4000  
 Operator : A 8726 MidSide MCR Spin fineness= 26.4 u  
 5% of fibres 11.3 u above mean. Comfort factor= 78.1 %  
 Curve= 53.6[46] deg/mm Curve number = 1442

Along: num= 1654 Mn= 26.2[ 5.9] Sd= 0.97[ 0.8] Min= 24.7[ 5.7] blob= 2.37[ 1.5] Sml= 1.04[ 0.7] Lge= 1.34[ 1.3] %  
 OFDA166:2.14 Cal: D=5.1599\*WH -2.98, wV= 1.4683\*wH+ -0.04, DkFlash= 83.0

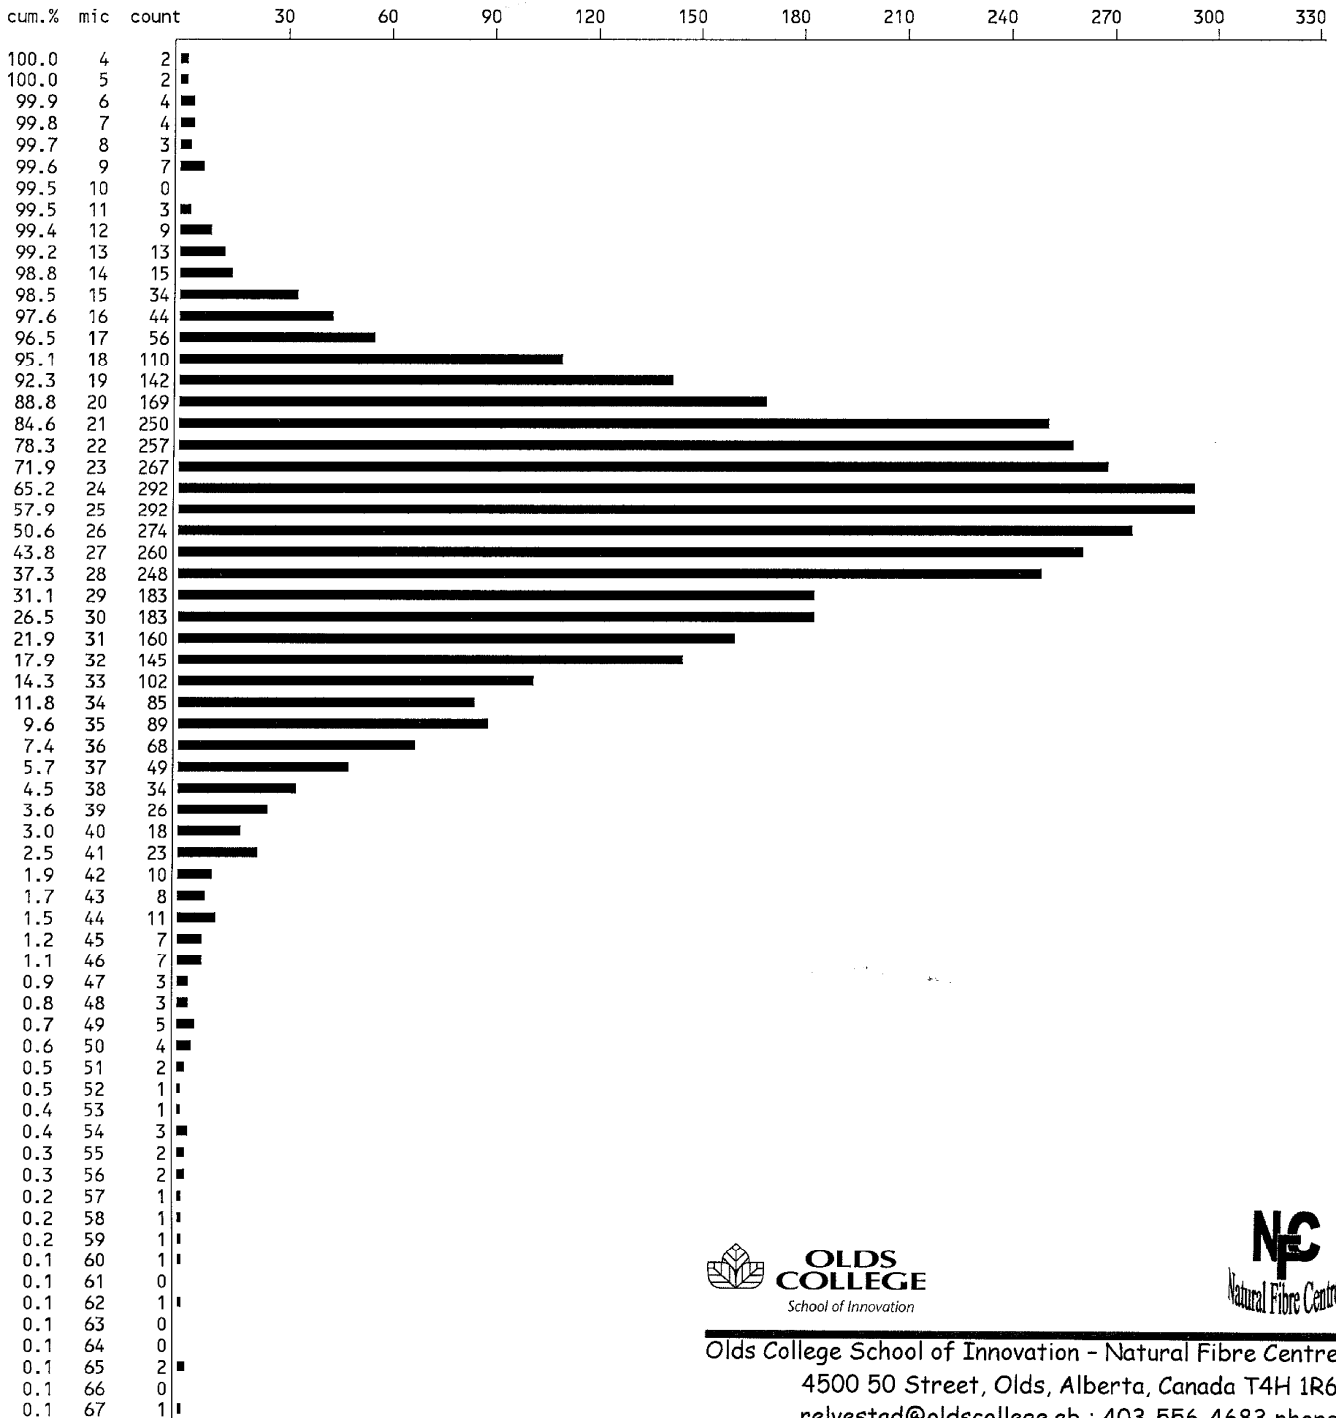

Olds College School of Innovation - Natural Fibre Centre  
 4500 50 Street, Olds, Alberta, Canada T4H 1R6  
[relvestad@oldscollge.ab](mailto:relvestad@oldscollge.ab) ; 403-556-4683 phone